



NATIONAL TECHNICAL UNIVERSITY OF ATHENS
SCHOOL OF MINING AND METALLURGICAL ENG.
LABORATORY OF METALLURGY

Technical Report TE 09/2017

THERMAL PROPERTIES OF 13KK33

Client:



KAKOYIANNIS BRICK FACTORY



APRIL 2017

Table of Contents

1. INTRODUCTION.....	3
2. METHODOLOGY.....	3
2.1. Material Properties.....	3
2.2. Geometry and Boundary Conditions	3
2.3. Computational details	5
3. RESULTS.....	5
3.1. Temperature Distribution.....	5
3.2. Thermal Properties.....	7
4. References	7

Client		Research / Study		Page 2
 KAKOYIANNIS BRICK FACTORY	KAKOYIANNIS BRICK FACTORY	 NATIONAL TECHNICAL UNIVERSITY OF ATHENS Laboratory of Metallurgy Dr. Anthimos Xenidis, Prof.		

1. INTRODUCTION

According to the relative order received in March 2017 from SABO S.A., the Laboratory of Metallurgy undertook the performance of determining the thermal properties of one (1) 13KK33. The technical specifications (geometry dimensions) of the 13KK33 was received on March 1st, 2017. The methodology followed for the analysis requested and the results obtained are presented in detail in this report.

2. METHODOLOGY

2.1. Material Properties


In the current study, porous clay and air are considered as homogeneous fluid continua and their properties as presented in Table 1. The thermal conductivity ($W/(m \cdot K)$) of air calculated according to EN 1745:2012, ISO 10211:2007 and ISO 6946 respectively [1-3].

Table 1. Properties of materials used in the computations.


Properties	Porous Clay	Air
Density (kg/m^3)	2000	1.23
Heat Capacity ($J/(kg \cdot K)$)	1000	1008
Thermal Conductivity ($W/(m \cdot K)$)	0.35	Geometry and Temperature Dependent

2.2. Geometry and Boundary Conditions

In Fig.1a and 1b the geometry dimensions of the 13KK33 and the respective domains are portrayed. The 13KK33 is insulated at the top and the bottom side. In the left side wall, corresponding to the external wall, a convective heat flux boundary condition was applied, with an external temperature of $0^\circ C$ and a heat transfer coefficient of $25 W/(m^2 \cdot K)$ [1-2]. Similarly, in the right side wall, corresponding to the inner wall, a convective heat flux boundary condition was applied, with a constant temperature of $20^\circ C$ and a heat transfer coefficient of $7.69 W/(m^2 \cdot K)$ [1-2].

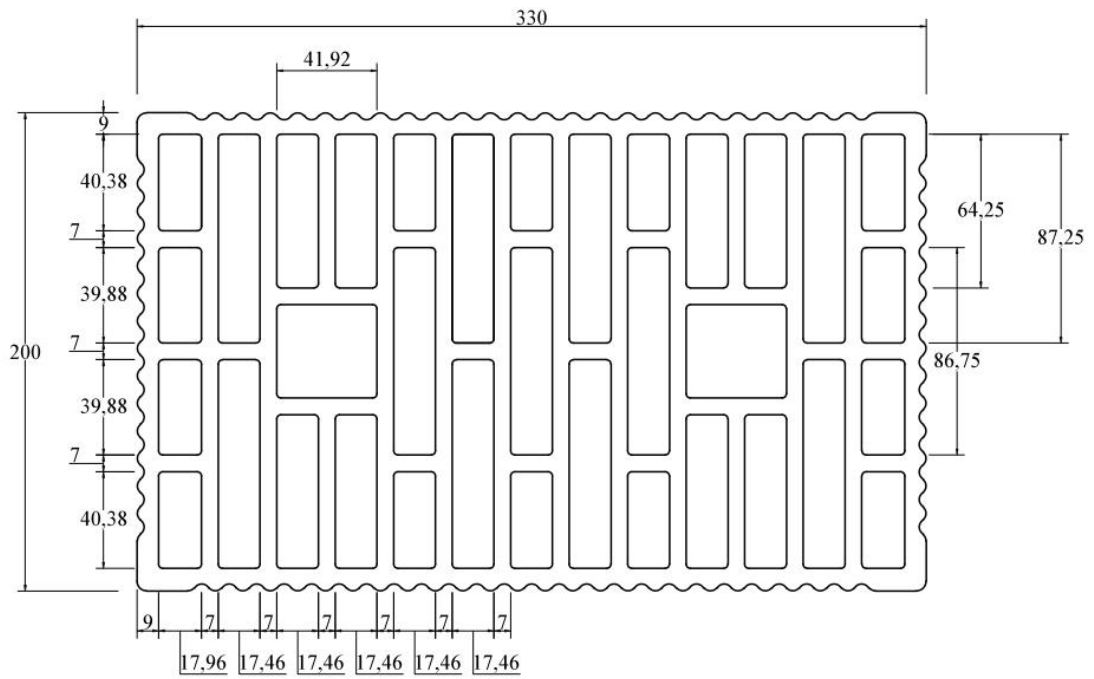

(a)

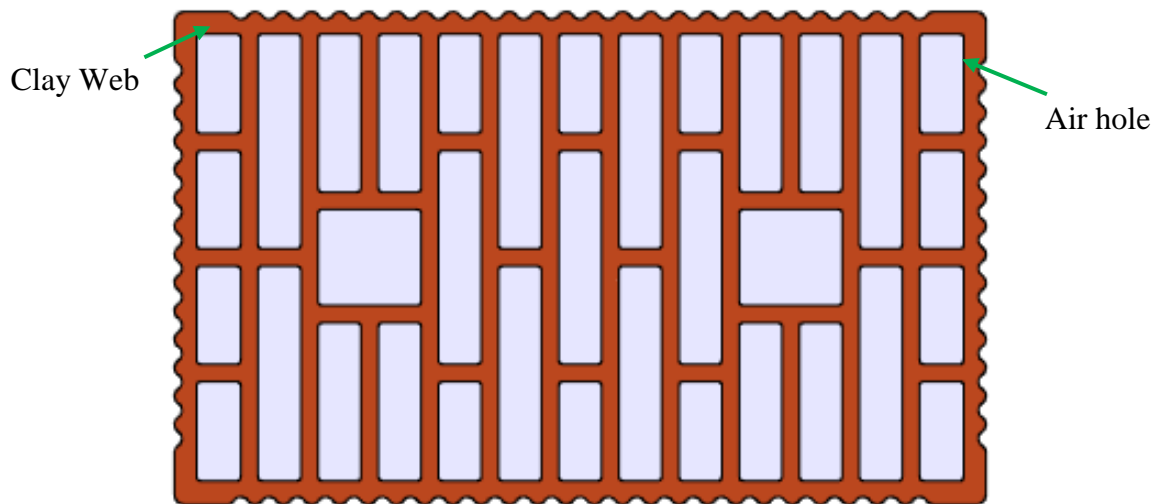

(b)

Fig. 1. (a) 13KK33 geometry dimensions in mm and (b) domains of porous clay and air holes.

2.3. Computational details

Convergence was assumed when the scaled residuals of the discretized equations fell below a preset tolerance of 10^{-6} . The thermal problem was solved with the stationary direct solver PARDISO. The grid consisted of 73.864 triangular mesh elements (see Fig.2) with the lowest element quality being equal to 0.62.

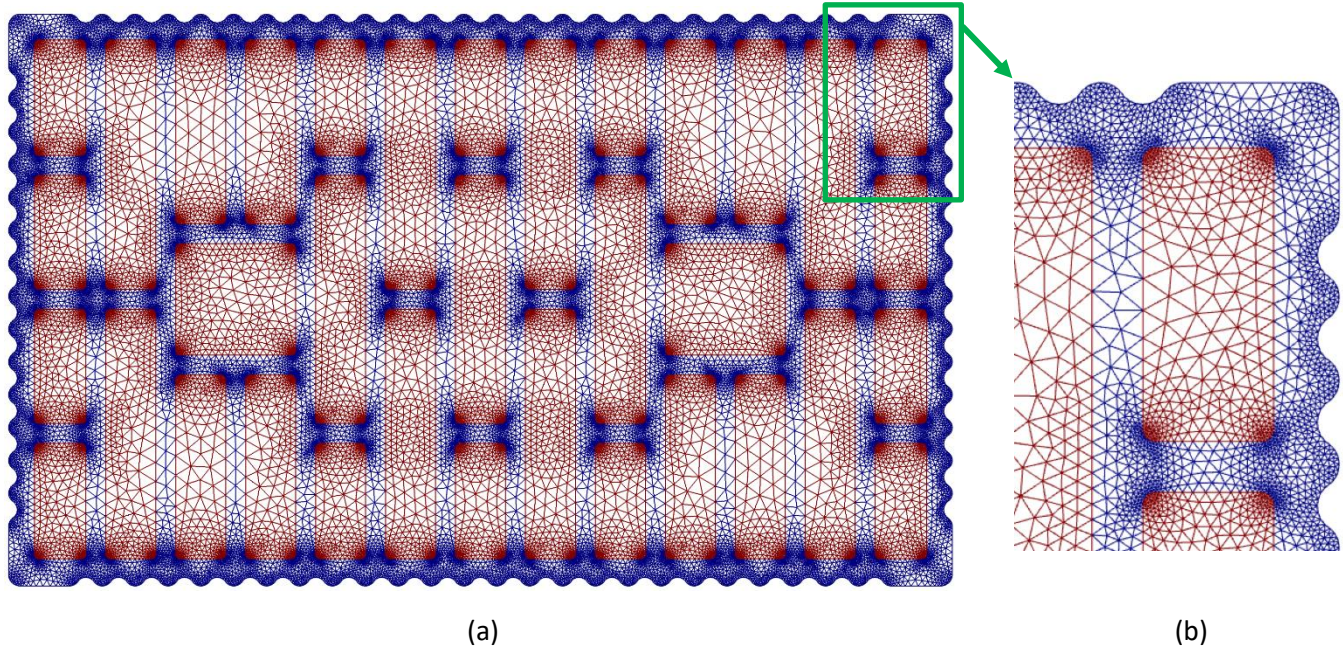





Fig.2. Schematic of the computational grid used (a) in the 13KK33 (b) around the air hole.

3. RESULTS


3.1. Temperature Distribution

In Figure 3a and 3b the temperature distribution and the isothermal contours are portrayed. The maximum temperature (293.15K) in the right side wall refers to the inner boundary condition and the lowest temperature (273.15K) refers to the left external wall.

Client		Research / Study		Page 5
 KAKOYIANNIS BRICK FACTORY	KAKOYIANNIS BRICK FACTORY	 NATIONAL TECHNICAL UNIVERSITY OF ATHENS Laboratory of Metallurgy Dr. Anthimos Xenidis, Prof.		

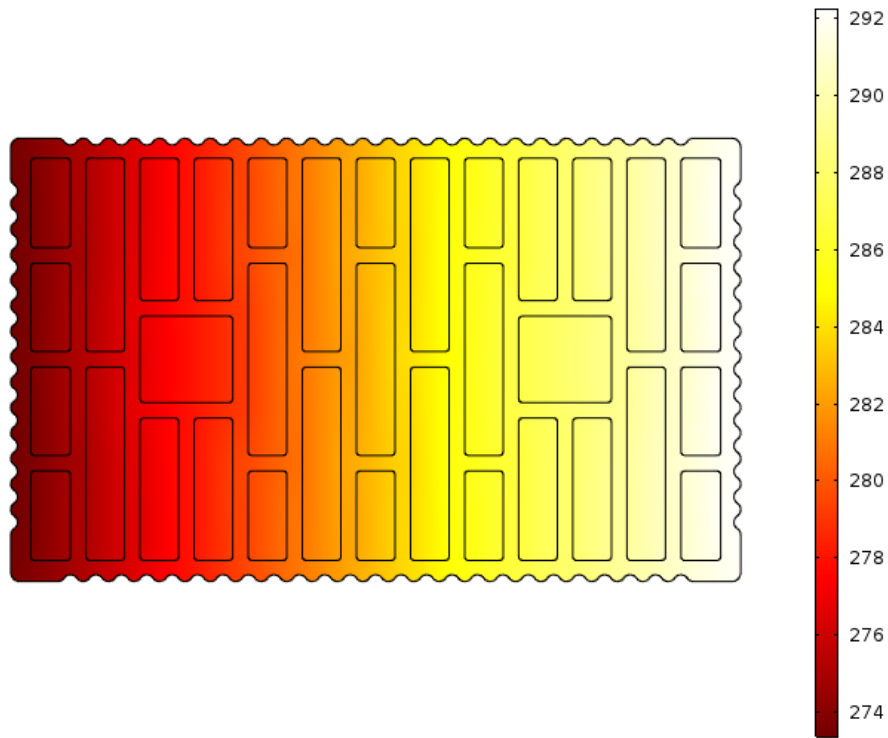

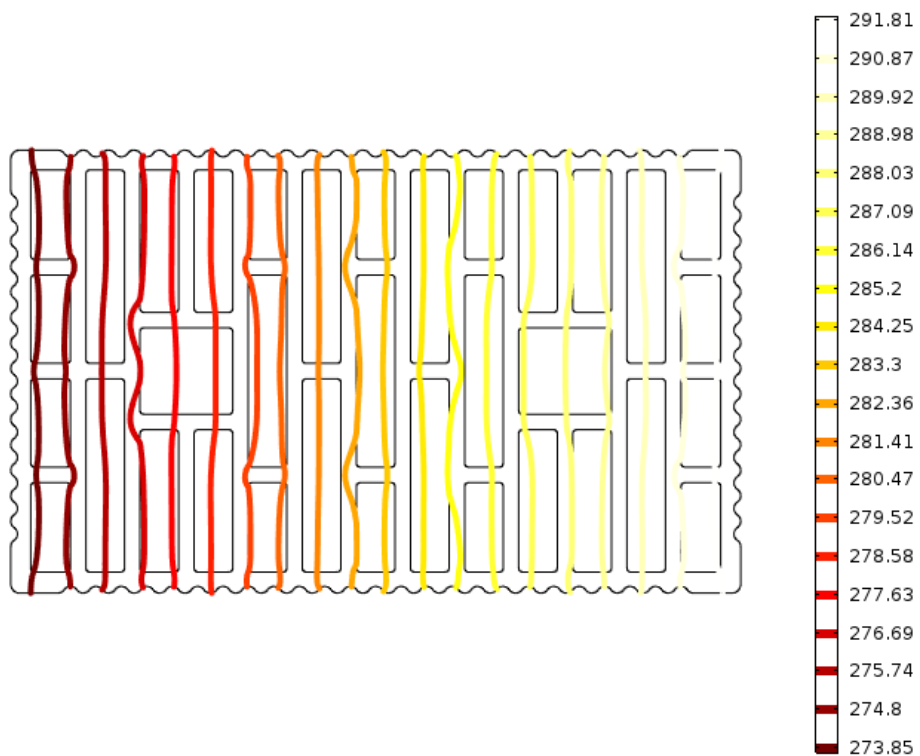

(a)



(b)

Fig3. (a) Temperature distribution in K and (b) isothermal contour in K.

Client		Research / Study		Page 6
 KAKOYIANNIS BRICK FACTORY	KAKOYIANNIS BRICK FACTORY	 NATIONAL TECHNICAL UNIVERSITY OF ATHENS Laboratory of Metallurgy Dr. Anthimos Xenidis, Prof.		

3.2. Thermal Properties

Based on the finite elements calculations, the effective thermal conductivity of the 13KK33 (see Fig. 1a and 1b) is $\lambda = 0.1269 \text{ W}/(\text{m}\cdot\text{K})$. The thermal transmittance of the 13KK33 is $U = 0.3846 \text{ W}/(\text{m}^2\cdot\text{K})$.


4. References

1. EN 1745, Masonry and masonry products: methods for determining design thermal values, April 2000.
2. EN ISO 10211:2007, Thermal bridges in building construction: heat flows and surface temperatures, 2007.
3. EN ISO 6946, Building components and building elements: thermal resistance and thermal transmittance, Calculation method.



PROJECT TEAM

K. Karalis, Mining & Metallurgical Engineer

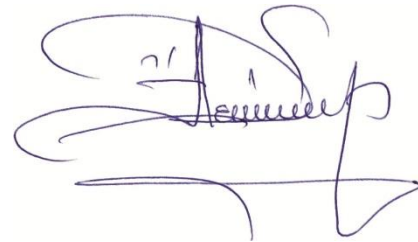Scientific responsible



Dr. Anthimos Xenidis
Professor

Client		Research / Study		Page 7
 KAKOYIANNIS BRICK FACTORY	KAKOYIANNIS BRICK FACTORY	 NATIONAL TECHNICAL UNIVERSITY OF ATHENS Laboratory of Metallurgy Dr. Anthimos Xenidis, Prof.		